



Typical Installation Images



Air Handler – Floor mounted



Air Handler – Hung from straps

AIRMAX

TECHNOLOGIES



ECM Air handler with optional Prioritization system



Air Handler with Optional Cooling Coil Filter Frame



Typical Diffuser Location Images



Floor Mounted Diffuser



Wall Mounted Diffuser



Ceiling Bulkhead Mounted Diffuser



Kick-plate Mounted Diffuser




Installation Checklist

Do – Ensure that the duct is installed with smooth radiuses and that the material is not damaged.



Do – Ensure that all perimeter duct connections are taped or sealed.

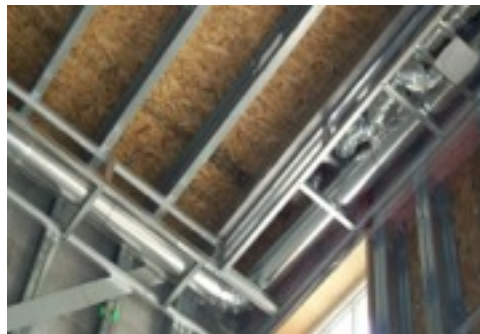

Do – Ensure that a drain has been installed on the Air handler water line






Do – Ensure that a dust cap has been installed on the Air Distribution outlets to protect against construction debris.



Do – Ensure the Air Distribution outlets are securely fastened.

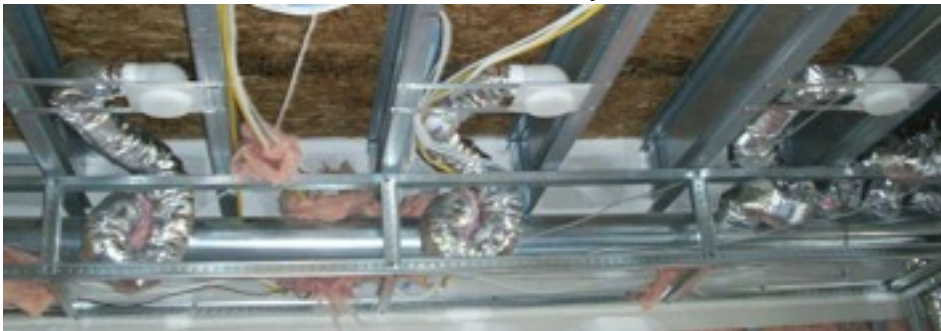

Do – Ensure that after finishes have been applied that diffusers are installed on all outlets, in the full open position.

